

FIRE SAFETY INSPECTION REPORT

**COMPTEX TEXTILES LTD.
VULTA, RUPGONJ, NARAYANGANJ**

OTHER FACTORIES: NONE



ACCORD
on Fire and Building Safety in Bangladesh

March 10, 2014

SUMMARY

Comptex Textiles Ltd. was surveyed for fire safety on 3/10/2014 by Hughes Associates, Inc. This summary identifies the major deficiencies that were identified during the inspection.

The purpose of this survey was to identify significant fire safety issues and to provide recommendations for remediation based on applicable standards specified by the Accord. The scope of this initial fire safety inspection was limited to the review and identification of major fire safety issues. The inspection did not include identification of minor deficiencies, which will be further addressed as part of follow-up inspections.

Tables 1 - 6 summarizes the major fire safety issues identified during the inspection. Recommendations have been provided to address each issue.

An implementation schedule shall be developed by the factory to remediate each of the findings. The specific timing of improvements, including any requested extensions due to design / installation constraints, shall be submitted to the Accord for approval.

Table 1. Findings And Recommendations - Comptex Textiles Ltd

No.	Category	Finding	Recommendation	Remediation Timeframe
F-1	Fire Rated Construction	The exit stairs are not separated from storage, work areas on each floor by fire-rated construction.	<p>Provide minimum 1.5-hr fire rated doors and seal all unprotected openings to separate the exit stairs from work areas and other building spaces on all floor levels. Ensure that the fire doors are self-closing and positive latching and that they are provided with fire exit (panic) hardware where serving production floors.</p> <p>If fire doors are required to be held open for functional reasons, provide automatic-closing devices tied to the fire alarm system.</p>	Within 3 months



F-2	Fire Rated Construction	Unsealed penetrations and openings are located in exit stair enclosures.	Seal all penetrations and openings in exit stair enclosure walls to maintain the fire separation.	Within 3 months
-----	-------------------------	--	---	-----------------



F-3	Fire Rated Construction	Unsealed penetrations and openings are located in the fire-rated floor/ceiling assemblies.	Provide a minimum 2-hr fire-rated shaft to separate the utility risers from each floor level.	Within 3 months
-----	-------------------------	--	---	-----------------

Seal all penetrations and openings in floor/ceiling assemblies to maintain the fire separation.



F-4	Fire Rated Construction	Areas used for combustible storage in 1st floor are not separated by fire-rated construction.	Provide dedicated storage rooms separated by minimum 1-hr fire-rated construction. Where separate storage rooms are not feasible, provide defined storage areas and limit the storage arrangement as follows: - Maximum height of 2.4m and maximum area of 23m ² - If sprinkler protected: maximum height of 3.66m and maximum area of 93m ² Separate areas of unenclosed combustible storage by a minimum clear distance of 3m.	Within 3 months
-----	-------------------------	---	--	-----------------



F-5	Egress	Egress doors/gates with locking features are provided at building exits, exit stairs, along egress routes, exit discharge.	Remove locking features from all egress doors / gates. If locks are required for security reasons, utilize special door locking features complying with NFPA 101.	Immediate
-----	--------	--	--	-----------






F-6 Egress

Collapsible gates / sliding doors are provided at building exits, exit stairs, along egress routes.

Replace all gates / sliding doors along the means of egress with side-hinged, swinging egress doors.

Within 1 month

If locks are required for security reasons, utilize special door locking features complying with NFPA 101.

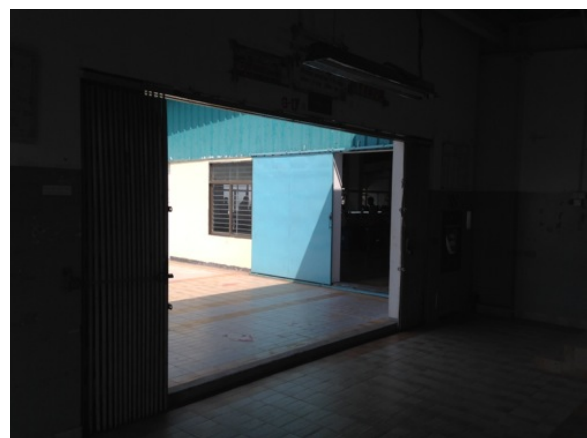



F-7	Egress	Common path of egress travel exceeds 30m on ground floor.	Reconfigure the egress arrangement to reduce the maximum common path of travel to not more than 30 m.	Within 3 months
-----	--------	---	---	-----------------



F-8	Fire Protection	The fire alarm system is antiquated, not a listed system, and does not provide alarm and notification features consistent with acceptable standards.	Replace the fire alarm system with a new, listed addressable fire alarm system in accordance with NFPA 72.	Design within 4 months, install within 9 months
-----	-----------------	--	--	---

F-9	Fire Protection	Inspection, testing, and maintenance records for the fire alarm system were not available.	Inspect, test and maintain the fire alarm system, and keep written records on-site, in accordance with NFPA 72.	Within 3 months
-----	-----------------	--	---	-----------------

Table 2. Findings And Recommendations - Printing Building

No.	Category	Finding	Recommendation	Remediation Timeframe
-----	----------	---------	----------------	--------------------------

F-1	Egress	Egress doors and gates with locking features are provided at building exits.	Remove locking features from all egress doors / gates. If locks are required for security reasons, utilize special door locking features complying with NFPA 101.	Immediate
-----	--------	--	--	-----------



F-2	Egress	Collapsible gates and sliding doors are provided at building exits.	Replace all gates / sliding doors along the means of egress with side-hinged, swinging egress doors. If locks are required for security reasons, utilize special door locking features complying with NFPA 101.	Within 1 month
-----	--------	---	--	-------------------



F-3	Egress	The exits are not remotely located from each other such that a single fire event could compromise both exits.	Modify exit arrangement or provide additional exit(s).	Within 6 months
-----	--------	---	--	-----------------



F-4	Fire Protection	The fire alarm system is antiquated, not a listed system, and does not provide alarm and notification features consistent with acceptable standards.	Replace the fire alarm system with a new, listed addressable fire alarm system in accordance with NFPA 72.	Design within 4 months, install within 9 months
-----	-----------------	--	--	---



F-5	Fire Protection	The building is not equipped with smoke alarms.	Replace the single-station smoke alarms with automatic smoke detectors tied into the fire alarm system. Configure the fire alarm system to initiate occupant notification upon activation of any two smoke detectors in addition to the manual fire alarm stations.	Within 6 months
-----	-----------------	---	---	-----------------

Table 3. Findings And Recommendations - Canteen

No.	Category	Finding	Recommendation	Remediation Timeframe
-----	----------	---------	----------------	--------------------------

F-1	Egress	Egress doors and gates with locking features are provided at building exits.	Remove locking features from all egress doors and gates. If locks are required for security reasons, utilize special door locking features complying with NFPA 101.	Immediate
-----	--------	--	--	-----------



F-2	Egress	Collapsible gates and sliding doors are provided at building exits.	Replace all gates and sliding doors along the means of egress with side-hinged, swinging egress doors. If locks are required for security reasons, utilize special door locking features complying with NFPA 101.	Within 1 month
-----	--------	---	--	-------------------



F-3	Fire Protection	The fire alarm system is antiquated, not a listed system, and does not provide alarm and notification features consistent with acceptable standards.	Replace the fire alarm system with a new, listed addressable fire alarm system in accordance with NFPA 72.	Design within 4 months, install within 9 months
-----	-----------------	--	--	---



F-4	Fire Protection	The building is not equipped with smoke alarms.	Replace the single-station smoke alarms with automatic smoke detectors tied into the fire alarm system. Configure the fire alarm system to initiate occupant notification upon activation of any two smoke detectors in addition to the manual fire alarm stations.	Within 6 months
-----	-----------------	---	---	-----------------

Table 4. Findings And Recommendations - Office/Knitting Building

No.	Category	Finding	Recommendation	Remediation Timeframe
F-1	Fire Rated Construction	The exit stairs are not separated from work areas on each floor by fire-rated construction.	<p>Provide minimum 1.5-hr fire rated doors and seal all unprotected openings to separate the exit stairs from work areas and other building spaces on all floor levels. Ensure that the fire doors are self-closing and positive latching and that they are provided with fire exit (panic) hardware where serving production floors.</p> <p>If fire doors are required to be held open for functional reasons, provide automatic-closing devices tied to the fire alarm system.</p>	Within 3 months



F-2	Fire Rated Construction	Unsealed penetrations and openings are located in the fire-rated floor/ceiling assemblies, specifically where the hose reels are recessed into the wall.	Provide a minimum 2-hr fire-rated shaft to separate the utility risers from each floor level. Seal all penetrations and openings in floor/ceiling assemblies to maintain the fire separation.	Within 3 months
-----	-------------------------	--	--	-----------------



F-3	Fire Rated Construction	Unsealed penetrations and openings are located in exit stair enclosures, specifically the electrical penetrations in the S exit stair at the ground floor.	Seal all penetrations and openings in exit stair enclosure walls to maintain the fire separation.	Within 3 months
-----	-------------------------	--	---	-----------------



F-4	Egress	Egress doors and gates with locking features are provided throughout the stairs	Remove locking features from all egress doors and gates. If locks are required for security reasons, utilize special door locking features complying with NFPA 101.	Immediate
-----	--------	---	--	-----------



F-5	Egress	Collapsible gates and sliding doors are provided throughout the stairs	Replace all gates and sliding doors along the means of egress with side-hinged, swinging egress doors. If locks are required for security reasons, utilize special door locking features complying with NFPA 101.	Within 1 month
-----	--------	--	--	----------------



F-6	Egress	Storage was located in the N exit stairs.	Remove all storage from exit stairs and egress paths.	Within 3 months
-----	--------	---	---	-----------------



F-7	Fire Protection	The fire alarm system is antiquated, not a listed system, and does not provide alarm and notification features consistent with acceptable standards.	Replace the fire alarm system with a new, listed addressable fire alarm system in accordance with NFPA 72.	Design within 4 months, install within 9 months
-----	-----------------	--	--	---



F-8	Fire Protection	Inspection, testing, and maintenance records for the fire alarm system were not available.	Inspect, test and maintain the fire alarm system, and keep written records on-site, in accordance with NFPA 72.	Within 3 months
-----	-----------------	--	---	-----------------



F-9	Fire Protection	The building is equipped with single-station smoke alarms. Smoke alarm activation sounds only a local alarm and does not provide automatic fire alarm notification of occupants.	Replace the single-station smoke alarms with automatic smoke detectors tied into the fire alarm system. Configure the fire alarm system to initiate occupant notification upon activation of any two smoke detectors in addition to the manual fire alarm stations.	Within 6 months
-----	-----------------	--	---	-----------------



Table 5. Findings And Recommendations - Service Building

No.	Category	Finding	Recommendation	Remediation Timeframe
-----	----------	---------	----------------	--------------------------

F-1	Egress	Egress doors and gates with locking features are provided at building exits.	Remove locking features from all egress doors / gates. If locks are required for security reasons, utilize special door locking features complying with NFPA 101.	Immediate
-----	--------	--	--	-----------



F-2	Egress	Collapsible gates and sliding doors are provided at building exits.	Replace all gates / sliding doors along the means of egress with side-hinged, swinging egress doors. If locks are required for security reasons, utilize special door locking features complying with NFPA 101.	Within 1 month
-----	--------	---	--	-------------------



F-3	Fire Protection	The building is not equipped with smoke alarms.	Replace the single-station smoke alarms with automatic smoke detectors tied into the fire alarm system. Configure the fire alarm system to initiate occupant notification upon activation of any two smoke detectors in addition to the manual fire alarm stations.
-----	-----------------	---	---

F-4	Fire Protection	The fire alarm system is antiquated, not a listed system, and does not provide alarm and notification features consistent with acceptable standards.	Replace the fire alarm system with a new, listed addressable fire alarm system in accordance with NFPA 72.	Design within 4 months, install within 9 months
-----	-----------------	--	--	---



F-5	Fire Protection	Inspection, testing, and maintenance records for the fire alarm system were not available.	Inspect, test and maintain the fire alarm system, and keep written records on-site, in accordance with NFPA 72.	Within 3 months
-----	-----------------	--	---	-----------------

Table 6. Findings And Recommendations - Comtex New Building

No.	Category	Finding	Recommendation	Remediation Timeframe
F-1	Fire Rated Construction	The exit stairs in basement are not separated from work areas on each floor by fire-rated construction.	<p>Provide minimum 1.5-hr fire rated doors and seal all unprotected openings to separate the exit stairs from work areas and other building spaces on all floor levels. Ensure that the fire doors are self-closing and positive latching and that they are provided with fire exit (panic) hardware where serving production floors.</p> <p>If fire doors are required to be held open for functional reasons, provide automatic-closing devices tied to the fire alarm system.</p>	Within 3 months



F-2	Fire Rated Construction	Areas used for combustible storage in ground floor are not separated by fire-rated construction.	<p>Provide dedicated storage rooms separated by minimum 1-hr fire-rated construction.</p> <p>Where separate storage rooms are not feasible, provide defined storage areas and limit the storage arrangement as follows:</p> <ul style="list-style-type: none">- Maximum height of 2.4m and maximum area of 23m²- If sprinkler protected: maximum height of 3.66m and maximum area of 93m² <p>Separate areas of unenclosed combustible storage by a minimum clear distance of 3m.</p>	Within 3 months
-----	-------------------------	--	---	-----------------





F-3	Egress	Egress doors, gates with locking features are provided at building exits, exit discharge.	Remove locking features from all egress doors / gates. If locks are required for security reasons, utilize special door locking features complying with NFPA 101.	Immediate
-----	--------	---	--	-----------



F-4	Egress	Storage and was located in the all exit stair.	Remove all storage from exit stairs and egress paths.	Immediate
-----	--------	--	---	-----------

F-5	Egress	Collapsible gates / sliding doors are provided at building exits, exit stairs, along egress routes, exit discharge.	Replace all gates / sliding doors along the means of egress with side-hinged, swinging egress doors. If locks are required for security reasons, utilize special door locking features complying with NFPA 101.	Within 1 month
-----	--------	---	--	----------------



F-6	Egress	Storage was located In basement in the exit stair.	Remove all storage from exit stairs and egress paths.	Within 3 months
-----	--------	--	---	-----------------



F-7	Fire Protection	The fire alarm system is antiquated, not a listed system, and does not provide alarm and notification features consistent with acceptable standards.	Replace the fire alarm system with a new, listed addressable fire alarm system in accordance with NFPA 72.	Design within 4 months, install within 9 months
F-8	Fire Protection	Inspection, testing, and maintenance records for the fire alarm system were not available.	Inspect, test and maintain the fire alarm system, and keep written records on-site, in accordance with NFPA 72.	Within 3 months
F-9	Fire Protection	The building is equipped with single-station smoke alarms. Smoke alarm activation sounds only a local alarm and does not provide automatic fire alarm notification of occupants.	Replace the single-station smoke alarms with automatic smoke detectors tied into the fire alarm system. Configure the fire alarm system to initiate occupant notification upon activation of any two smoke detectors in addition to the manual fire alarm stations.	Within 6 months

